
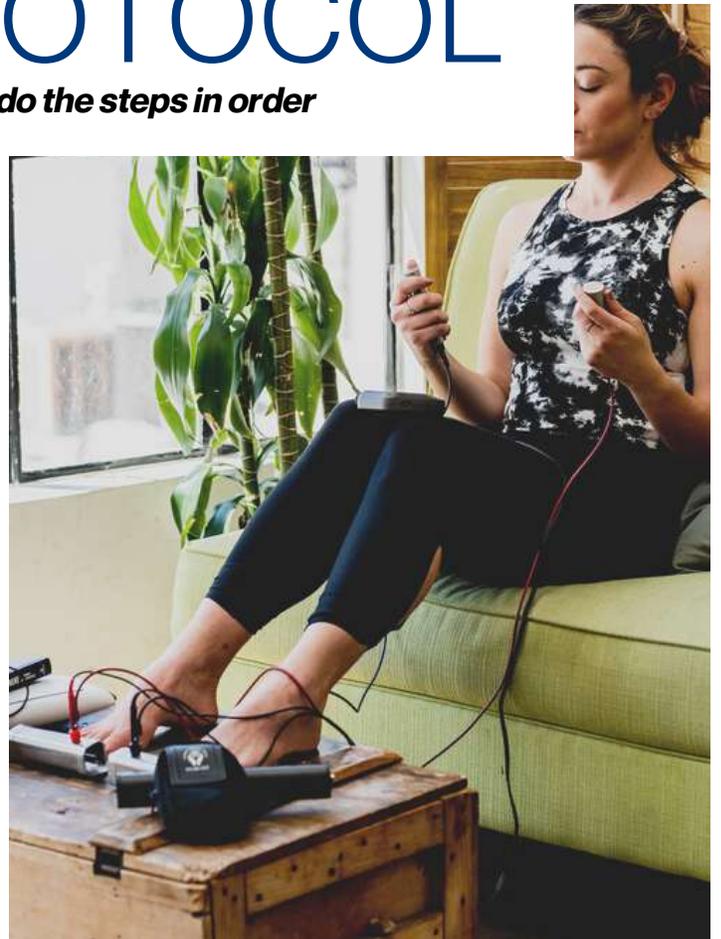


# HEALING IS VOLTAGE™ DAILY PROTOCOL

*Please make sure you do the steps in order*

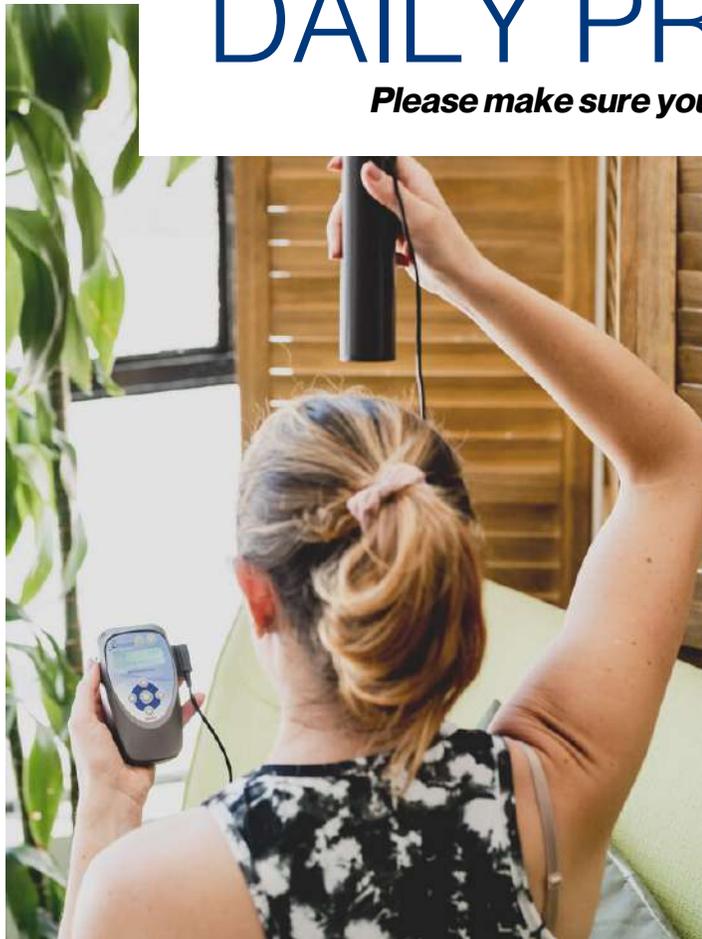

# STEP 1

## RECHARGE THE PRIMARY VOLTAGE CIRCUIT (LIVER/GALL BLADDER)



Place the Y Electrode right at the base of the hairline. This can be done on your own, or with someone holding the Y Electrode in place.

## SETTINGS:


- Connect BioModulator® Pro to Y Electrode.
- Set BioModulator® Pro or Plus to Ten-8.
- For the Pro: Turn the power up until you feel a tingle and then hold electrode at base of skull until the display reads DZ.
- For the Plus: hold at the back of the neck for 3 minutes



# STEP 2

## RESET AUTONOMIC NERVOUS SYSTEM (BOWLING BALL SYNDROME)

*For anxiety, depression, insomnia, managing stress and PTSD.*

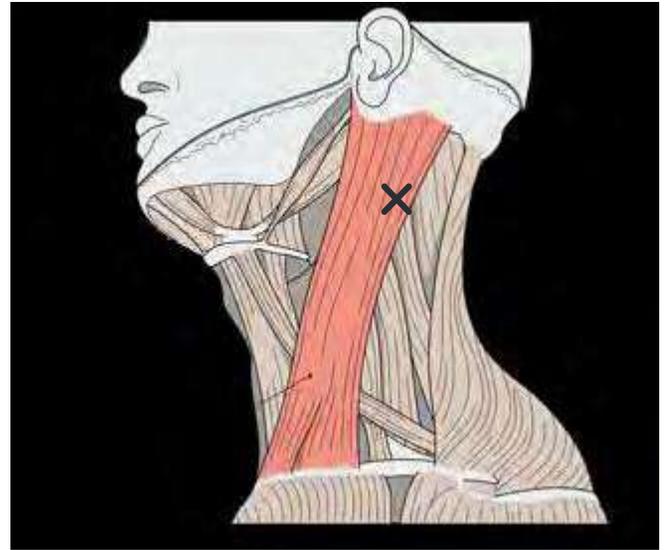


### SCM muscle placement


Place the Y Electrode on the muscle below the ear. The Y Electrode can be horizontal as shown in the picture to the right straddling the SCM muscle. Or vertical going down the SCM muscle. Most people prefer to go vertical in the same direction as the muscle. **You set your power level in the Ten- 8 mode but you will be doing the therapy in Infinity.**

Without taking it off the neck, switch to the Infinity mode and hold for **3 minute per side**. This should be relaxing, like a mini meditation. So, find a quiet place to do this therapy. Be patient, close your eyes and relax.

Please note, on Infinity mode you may not feel anything for 30 seconds or so, and then you will feel the tingle again. The frequency moves through your body like a figure 8.

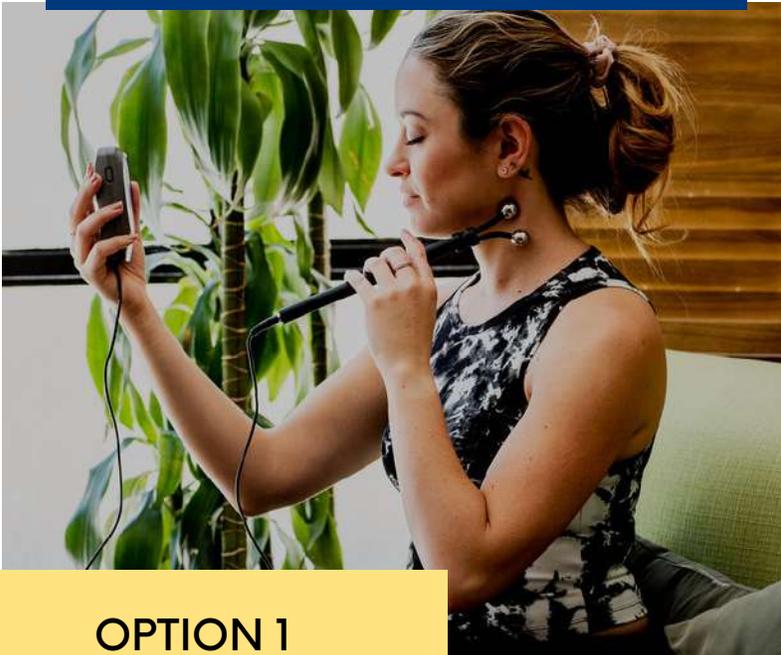

### OPTION 1

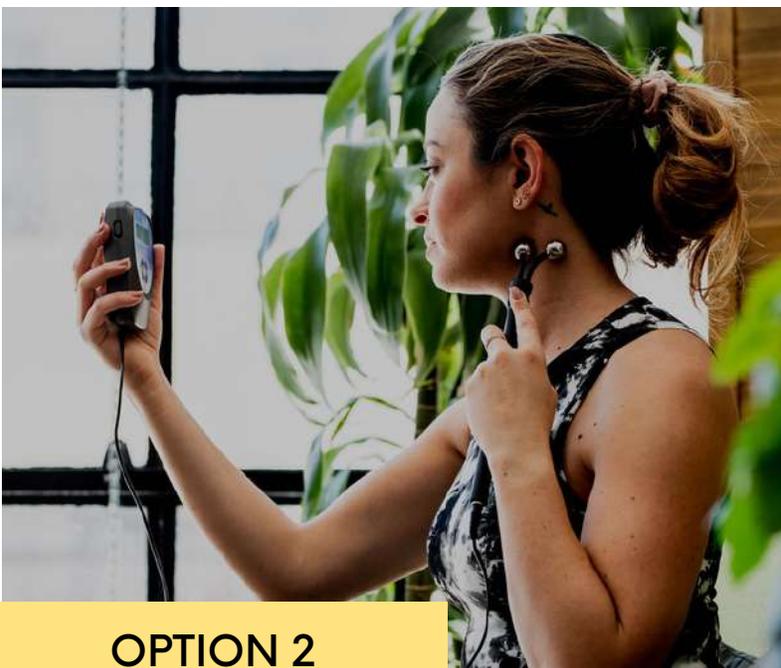

### OPTION 2

**This is an additional bonus if you have a partner: reset autonomic ganglia along the spine using Ten-8 in BioModulator® PLUS or BioModulator® Pro**

Place the Y Electrode at the top of your spine, turn the PLUS or PRO to Ten-8 and turn power up to what is a gentle feel. Go down the spine slowly from top to bottom 10 times.



This corrects the polarity of all circuits.

**SETTINGS:**

Direct the BioTransducer® either up the spine between the legs or hold it above your head with the device pointing down the spine, to correct the circuits and BioTerminal points. It works with just the photonics of the BioTransducer® or you may use the BioModulator®.




For Pro, set mode to **783 Harmonics** and set power to **250**.

**OR**



For Plus, set mode to **Ten-8** and set power to the **solid orange dot**.



Duration: **5 minutes** for **BioTransducer® Pro**

**OR**



Duration: **15 minutes** for **Crystal Wave**

**STEP 3**

**CORRECT POLARITY**



If you don't have a stand to assist you in holding it on top of your head, you may complete this step by lying down and resting the BioTransducer® on the crown of the head or between the legs. If it is on top of your head, shine the BioTransducer down your spine, and if it is between your legs, shine it up towards your spine.

# STEP 4

## ACTIVATE FETAL WIRING SYSTEM



Point the BioTransducer® at the belly button. This step can be done with clothes on. The energy emitted from the BioTransducer® will pass through clothing.

This will turn on all the organs of the body's original wiring system found at the umbilicus.

### SETTINGS:

Connect BioModulator® to BioTransducer® and set to Infinity mode and raise the power of the BM to the highest level.




For **Pro**, set mode to Infinity and set power to 250.

OR



For Plus, set mode to **Infinity** and set power to the **solid orange dot**.



### DURATION:

For Pro: **5 minutes per day**




OR



For CrystalWave: **15 minutes per day**

# STEP 5

## TOTAL BODY RECHARGE

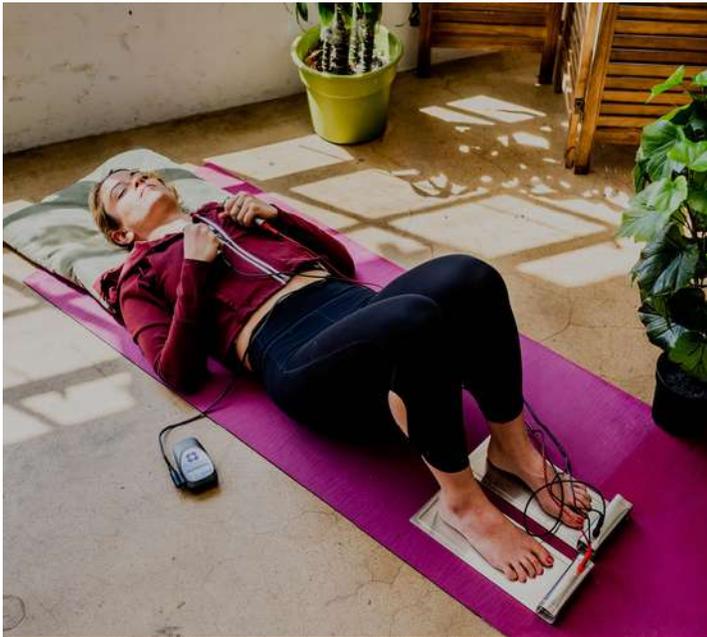

You may perform this step sitting up or laying down. Also, it is normal to only feel the tingling sensation on one or both hands during this step of the therapy. The soles of the feet are thicker, so you may not feel the tingling there.

This recharges the whole body's battery packs. Remember you have to correct the polarities before the batteries will take a charge!

If you are active/using for preventative you can skip this step.

### SETTINGS:

Connect the handgrips and footplates to the BioModulator®.




OR



For Pro, set mode to **Solfeggio**.

For Plus, set mode to **Ten-8**.




Left hand  
**RED**

Right hand  
**BLACK**

Left foot  
**BLACK**

Right foot  
**RED**



While holding the handgrips, power the BioModulator® to what is **gentle and comfortable**.

Duration:  
**30 min**


See next pages for how to configure the hand grips and foot plates.

# HANDGRIP + FOOTPLATE CONFIGURATION

## STEP 1

Grab the separate **red** and **black banana** bridge wires.

These will “bridge” the handgrips and footplates together so you can use them at the same time.

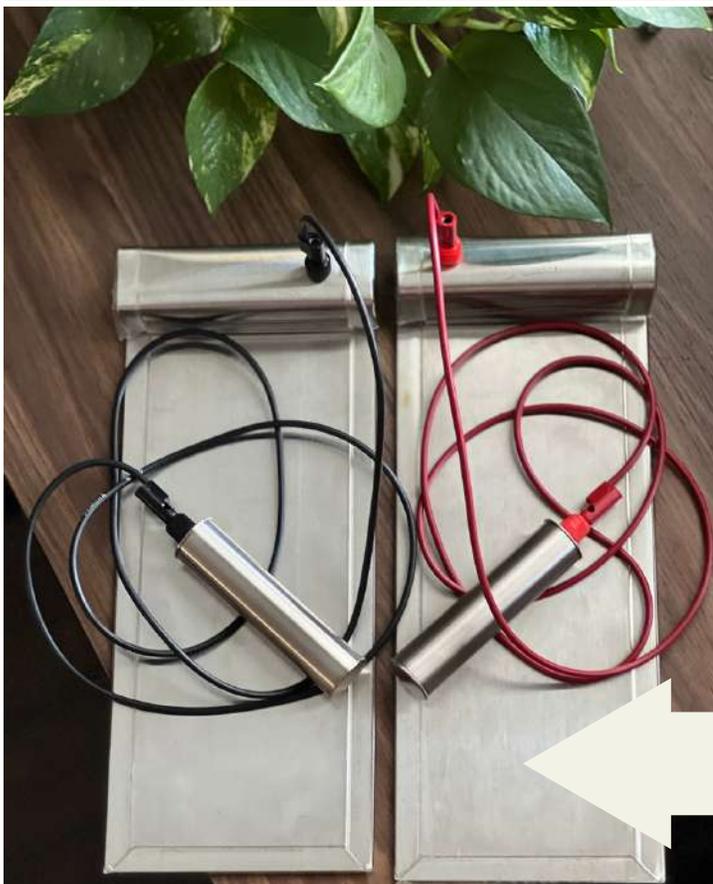

## STEP 2

Connect one end of the **red** bridge wire to the **red** footplate.

-and-

Connect one end of the **black** bridge wire to the **black** footplate.


# CONFIGURATION CONTINUED...

## STEP 3

Connect the other end of the **red** bridge wire to the **red** handgrip.

-and-

Connect the other end of the **black** bridge wire to the **black** handgrip.

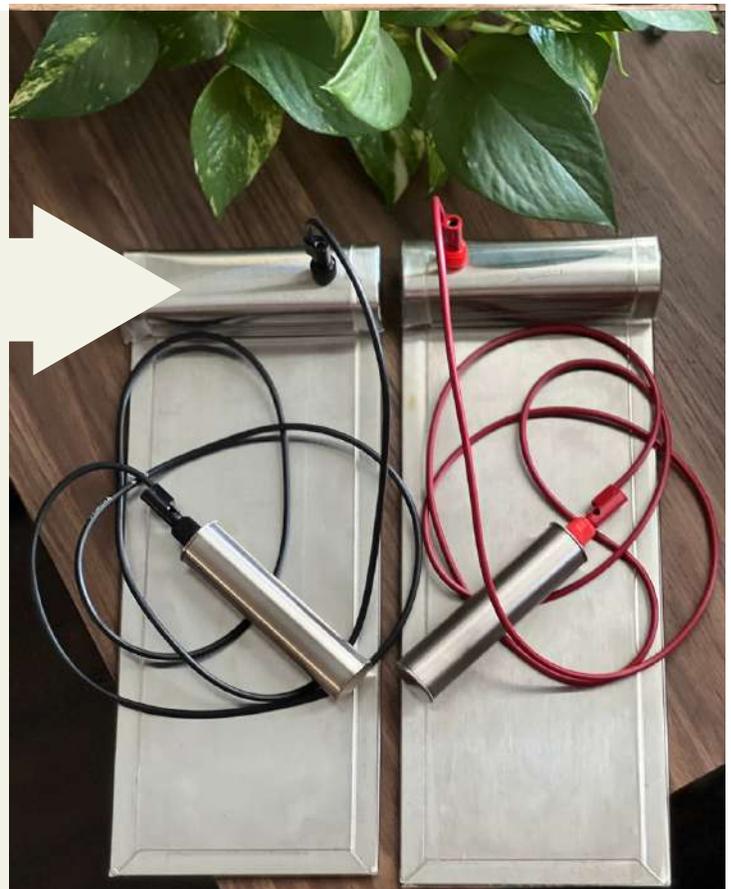

## STEP 4

Grab the lead wire that connects to the BioModulator® and has an end with a **red** and **black** split wire.


Connect to the BioModulator®.



# CONFIGURATION CONTINUED...


## STEP 5

Insert the **red** end of the lead wire into the open space on the **red** bridge wire up near the handgrip.

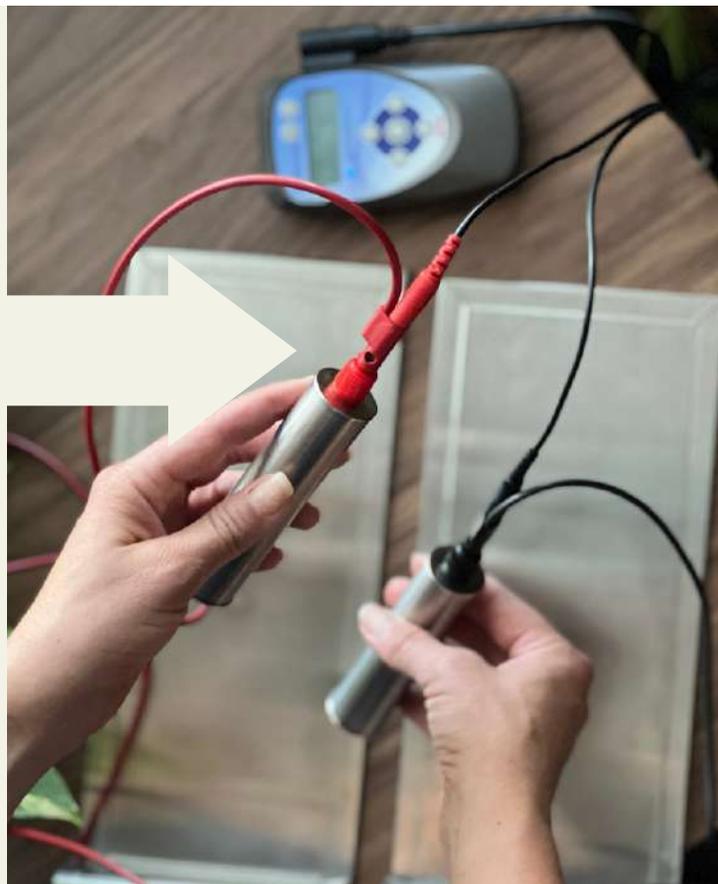

## STEP 6

Insert the **black** end of the lead wire into the open space on the **black** bridge wire up near the handgrip.

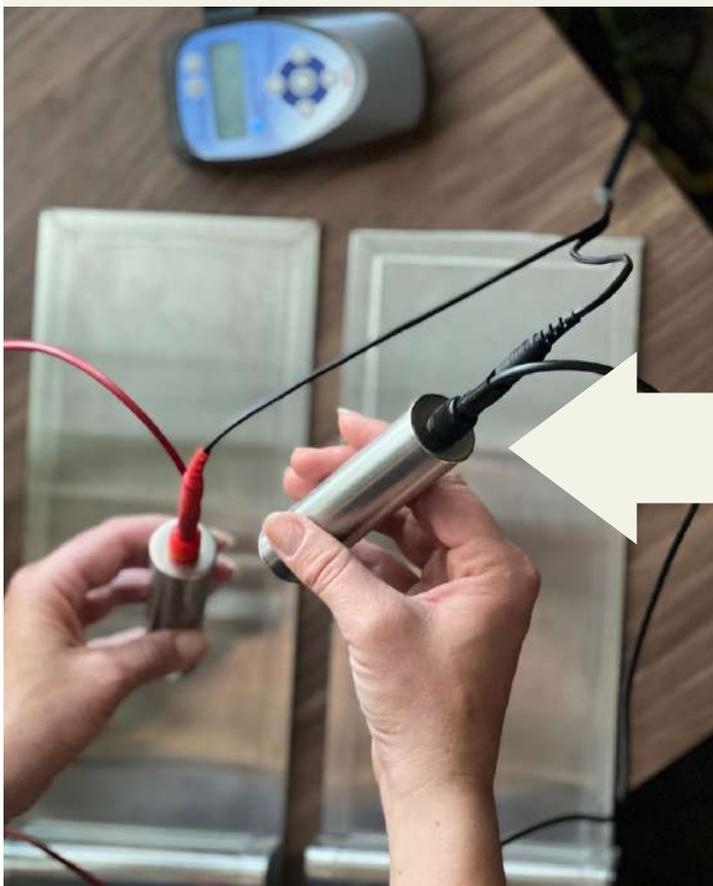

# CONFIGURATION CONTINUED...

## STEP 7

Handgrips and footplates are now configured to work together at the same time.



REMEMBER:

**ALL SET**

LEFT HAND  
**RED**

RIGHT HAND  
**BLACK**

LEFT FOOT  
**BLACK**

RIGHT FOOT  
**RED**

# ADDRESS AREA OF CONCERN



## SETTINGS:

- **Now that you have completed the daily steps, your body is now primed and prepped to receive additional therapies on areas of concern like general pain, eye therapy, organ therapy, etc**
- Connect the BioModulator® PRO or PLUS to your BioTransducer®.
- Select TEN-8 for pain or use one of the 60 modes in the BioModulator® Pro that is better suited to your area of concern.
- Make sure it is connected to the BioTransducer® and raise the power up to 250 in the PRO (or all the way up to the orange dot in the Plus).
- Point the BioTransducer® at the area for 15-20 min of therapy.
- Make sure it is connected to the BioTransducer® and raise the power up to 250 in the PRO (or all the way up to the orange dot in the Plus).
- Point the BioTransducer® at the area for 15-20 min of therapy.
- It is important to listen to your body and make modifications if needed. Consider lowering the power level of the BioTransducer® or shortening the therapy time.